

Annexure-C

SAFE DRINKING WATER AND SANITARY CONDITION CERTIFICATE

Letter No..7.15..... जल परीक्षण /34

Date: 23/04/2026

It is certified that an inspection team headed by SAURABH KUMAR (CHEMIST) from DISTRICT WATER ANALYSIS LABORARY U.P. JAL NIGAM (RURAL), MAINPURI inspected the BALA JI GLOBAL ACADEMY AHIRWA FARDPUR ROAD MAINPURI on 22 Apr. 2026 and on the basis of Water Test Report (Attached) bearing no 963 dated 23/04/2026 of DISTRICT WATER ANALYSIS LABORARY, U.P. JAL NIGAM (RURAL), MAINPURI certified that the BALA JI GLOBAL ACADEMY AHIRWA FARDPUR ROAD MAINPURI has safe drinking water facilities for the students and staff of the institution. School also maintains the hygienic sanitation condition in the school building & campus as per norms prescribed by the U.P. Govt.

This certificate is valid till 21/10/2026.

Signature with Seal:

Name

Assistant Engineer
Divisional Officer UPTN (Rural)
Mr. Rohitendra Kumar
Mainpuri (U.P.)

Designation : Assistant Engineer

Name & Address of the office

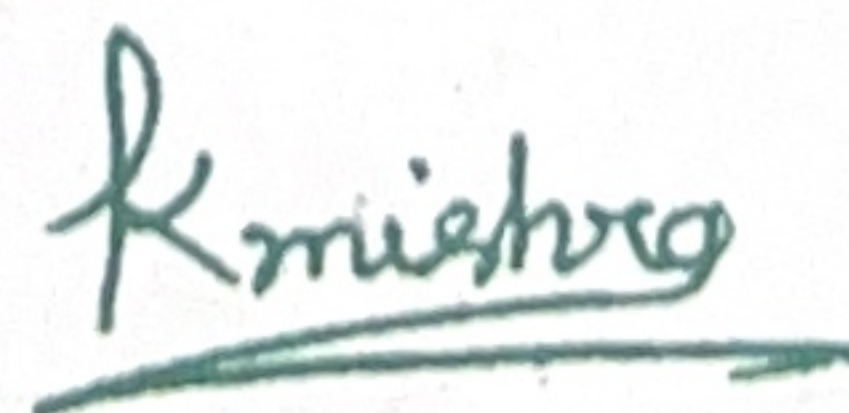
/Department : U.P. JAL NIGAM (RURAL)
MAINPURI (U.P.)

To

BALA JI GLOBAL ACADEMY,
AHIRWA FARDPUR ROAD MAINPURI
MAINPURI (U.P.)


Manager

Balaji Global Academy
Ahirwa, Fardpur Road, Mainour



PRINCIPAL
BALAJI GLOBAL ACADEMY
(Affi. No.2133437. Sch.Code-61334)
Ahirwa Fardpur Road, Mainpuri (U.P.)



District Level Water Analysis Laboratory
UP Jal Nigam (Rural), Power House Road
Mainpuri - 205001
(An NABL Accredited Laboratory)



TC-12297

TEST REPORT

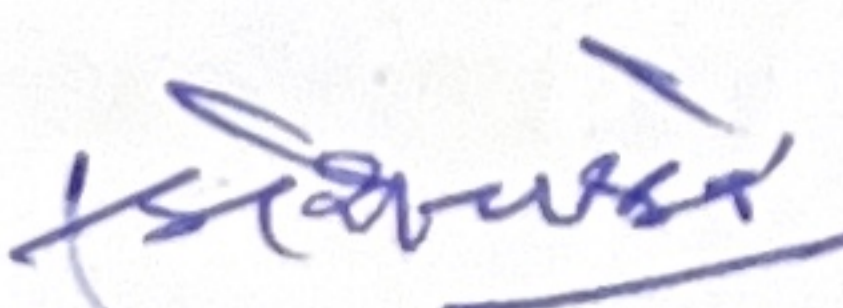
Page No. 1


Report No.	963	Date : 23/04/2026
Customers Details		
Office Name & Address : BALAJI GLOBAL ACADEMY AHIRWA FARDPUR ROAD MAINPURI		
Ref. Letter No. & Date : 0		
Basic Detail of Sample		
Address :	BALAJI GLOBAL ACADEMY AHIRWA FARDPUR ROAD MAINPURI	
Water Source	TW	Sample No. Pvt857386
Quantity of Sample	1lt	Date of Sample Collection Date 22/04/2026
Receiving Date	22/04/2026	Sample Collector Vijay pratap
Sample Depositor	DEO	Sampling Method IS : 17614(part-1):2021
Analysis start Date	23/04/2026	Analysis Completion Date 23/04/2026

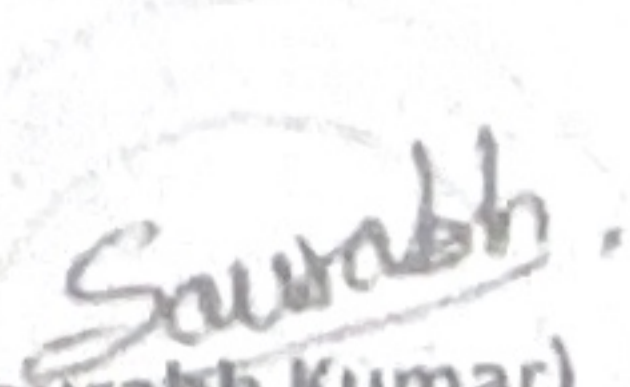
Environmental Condition		
Temperature	25.7°C	Humidity 49%

S.No	Analysis Parameter	Units	Observed Value	Specified Values as per BIS 10500:2021		Ref. Method of Analysis
				Acceptable Limit	Permissible Limit	
1	2	3	4	5	6	7
1	Colour*	Hazen	0	5	15	IS 3025(Part 4):2023(Platinum Cobalt Visual Comparison Methode)
2	Taste*	-	Agreeable	Agreeable	Agreeable	IS 3025 (Part 8) :2023
3	Odour*	-	Agreeable	Agreeable	Agreeable	IS 3025 (Part 5) :2021
4	pH (at 27°C)*	-	8.06	6.5-8.5	6.5-8.5	IS 3025 (Part 11) : 2022 (Electrometric Method)
5	Turbidity*	(NTU)	3.354	1.00	5.00	IS 3025 (Part 10) : 2023(Nephelometric Method)
6	TDS*	(mg/L)	227	500	2000	IS 3025 (Part 16) : 2023(Gravimetric Method)
7	Chloride*	(mg/L)	17	250	1000	IS 3025 (Part 32) : 2019 (Argentometric Method)
8	Total Alkalinity*	(mg/L)	110	200	600	IS 3025 (Part 23) : 2023 (Indicator Method)
9	Fluoride*	(mg/L)	-	1	1.5	APHA 24 th Edition-4500-F Method C (Electrode Method) : 2023
10	Total Hardness*	(mg/L)	180	200	600	IS 3025(Part 21):2023 (EDTA Method)
11	Sulphate*	(mg/L)	8.18	200	400	APHA 24th Edition -4500-SO4 Method F : 2023
12	Calcium*	(mg/L)	40.88	75	200	IS 3025(Part 40):2024 (EDTA Titrimetric Method)
13	Magnesium*	(mg/L)	18.72	30	100	IS 3025(Part46):2023
14	Iron*	(mg/L)	0.94	0.3	1.0	APHA 24th Edition - 3500-Fe Method B (Phenanthroline Method):2023
15	Nitrate*	(mg/L)	21.73	45	No Relaxation	APHA 24th Edition -4500- NO3 Method B (UV Screening Method): 2023

- Note:-**
1. This certificate refers only to the particular sample(s) submitted for testing.
 2. This certificate shall not be reproduced except in full, unless written permission for the publication of an approved abstract has been obtained from Head of Laboratory.
 3. The Test result reported in this certificate is valid at the time of and under the stated conditions of measurements.
 4. Sample will be stored up to 07 days (in case of non-perishable items only) from the date of issue of test reports unless otherwise specified.


Manager
Balaji Global Academy
Ahirwa, Fardpur Road, Mainpur


PRINCIPAL
BALAJI GLOBAL ACADEMY
(Affi. No.2133437. Sch.Code-61334)
Ahirwa Fardpur Road, Mainpuri (U.P.)


(Saurabh Kumar)
Technical Manager